




- Correct Phase Sequence
- Reversed Phase Sequence
- Supply Line Voltage Imbalance
- Loss of a Supply Phase Voltage

Specifications

Voltage range:	Scale:
100-120VAC	0-150V
200-240VAC	0-300V
380-415VAC	0-500V
440-460VAC	0-600V
Frequency range:	50/60Hz
Contact Rating:	
AC:	2A, 230V, 800VA
DC:	0,2A, 50W
Limits:	
Phase unbalance:	80% of highest phase
Phase sequence:	27 degrees +/- 3 degrees (4 degrees hysteresis)
Temperature:	-20 to +70°C
Weight:	0.6kgs
Front protection:	IP52 (IP65 optional)

The unit meets IEC60092-504 and the relevant environmental and EMC tests specified in IEC60068/60092 and IEC61000/60533 respectively, to comply with the requirements of the major Classification Societies.

Dimensions

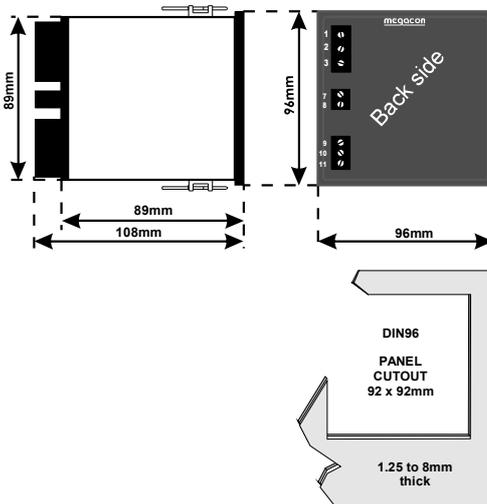

Description

KSP34E2 protects and safeguards personnel and equipment against injury and damage due to reversed rotation, and is a must for ship's shore connection, mobile installations and non-permanent installations. KSP34E2 is to be connected to the supply line voltages.

The KSP34E2 is a moving iron voltmeter incorporating a phase sequence and phase failure trip relay.

The voltmeter can be connected permanently to any one line voltage or via a selector switch to measure all three line voltages.

LEDs indicate the phase sequence (direction of rotation), supply failure or voltage imbalance:

- Green Correct Rotation
- Red Reversed Rotation/Supply Failure*
- Red Voltage Imbalance


The trip relay can be used for alarm purposes or to control automatic phase sequence correction relays.

KSP34E2 is insensitive to regenerative power loads, and is designed to function with both loaded and unloaded motors, regenerative four-quadrant drive systems etc.

The unit does not respond to voltage imbalance within the specified line voltage range.

*** Note:**

Since unit is powered from terminal 1 & 2, a supply failure of L1 or L2 will be indicated when all LED's are off. The output relay will have correct status.

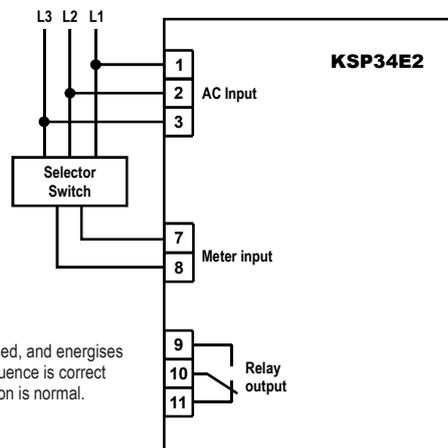

Relay shown de-energised, and energises only when phase sequence is correct and supply condition is normal.